


**Minimum Spread 18'**

**This is a Florida Fancy**  
Spread and caliper are Fish Branch minimums  
All other criteria from Florida Grades & Standards apply

Minimum caliper before trim 17.5" - 18"  
After trim 16" at 3'

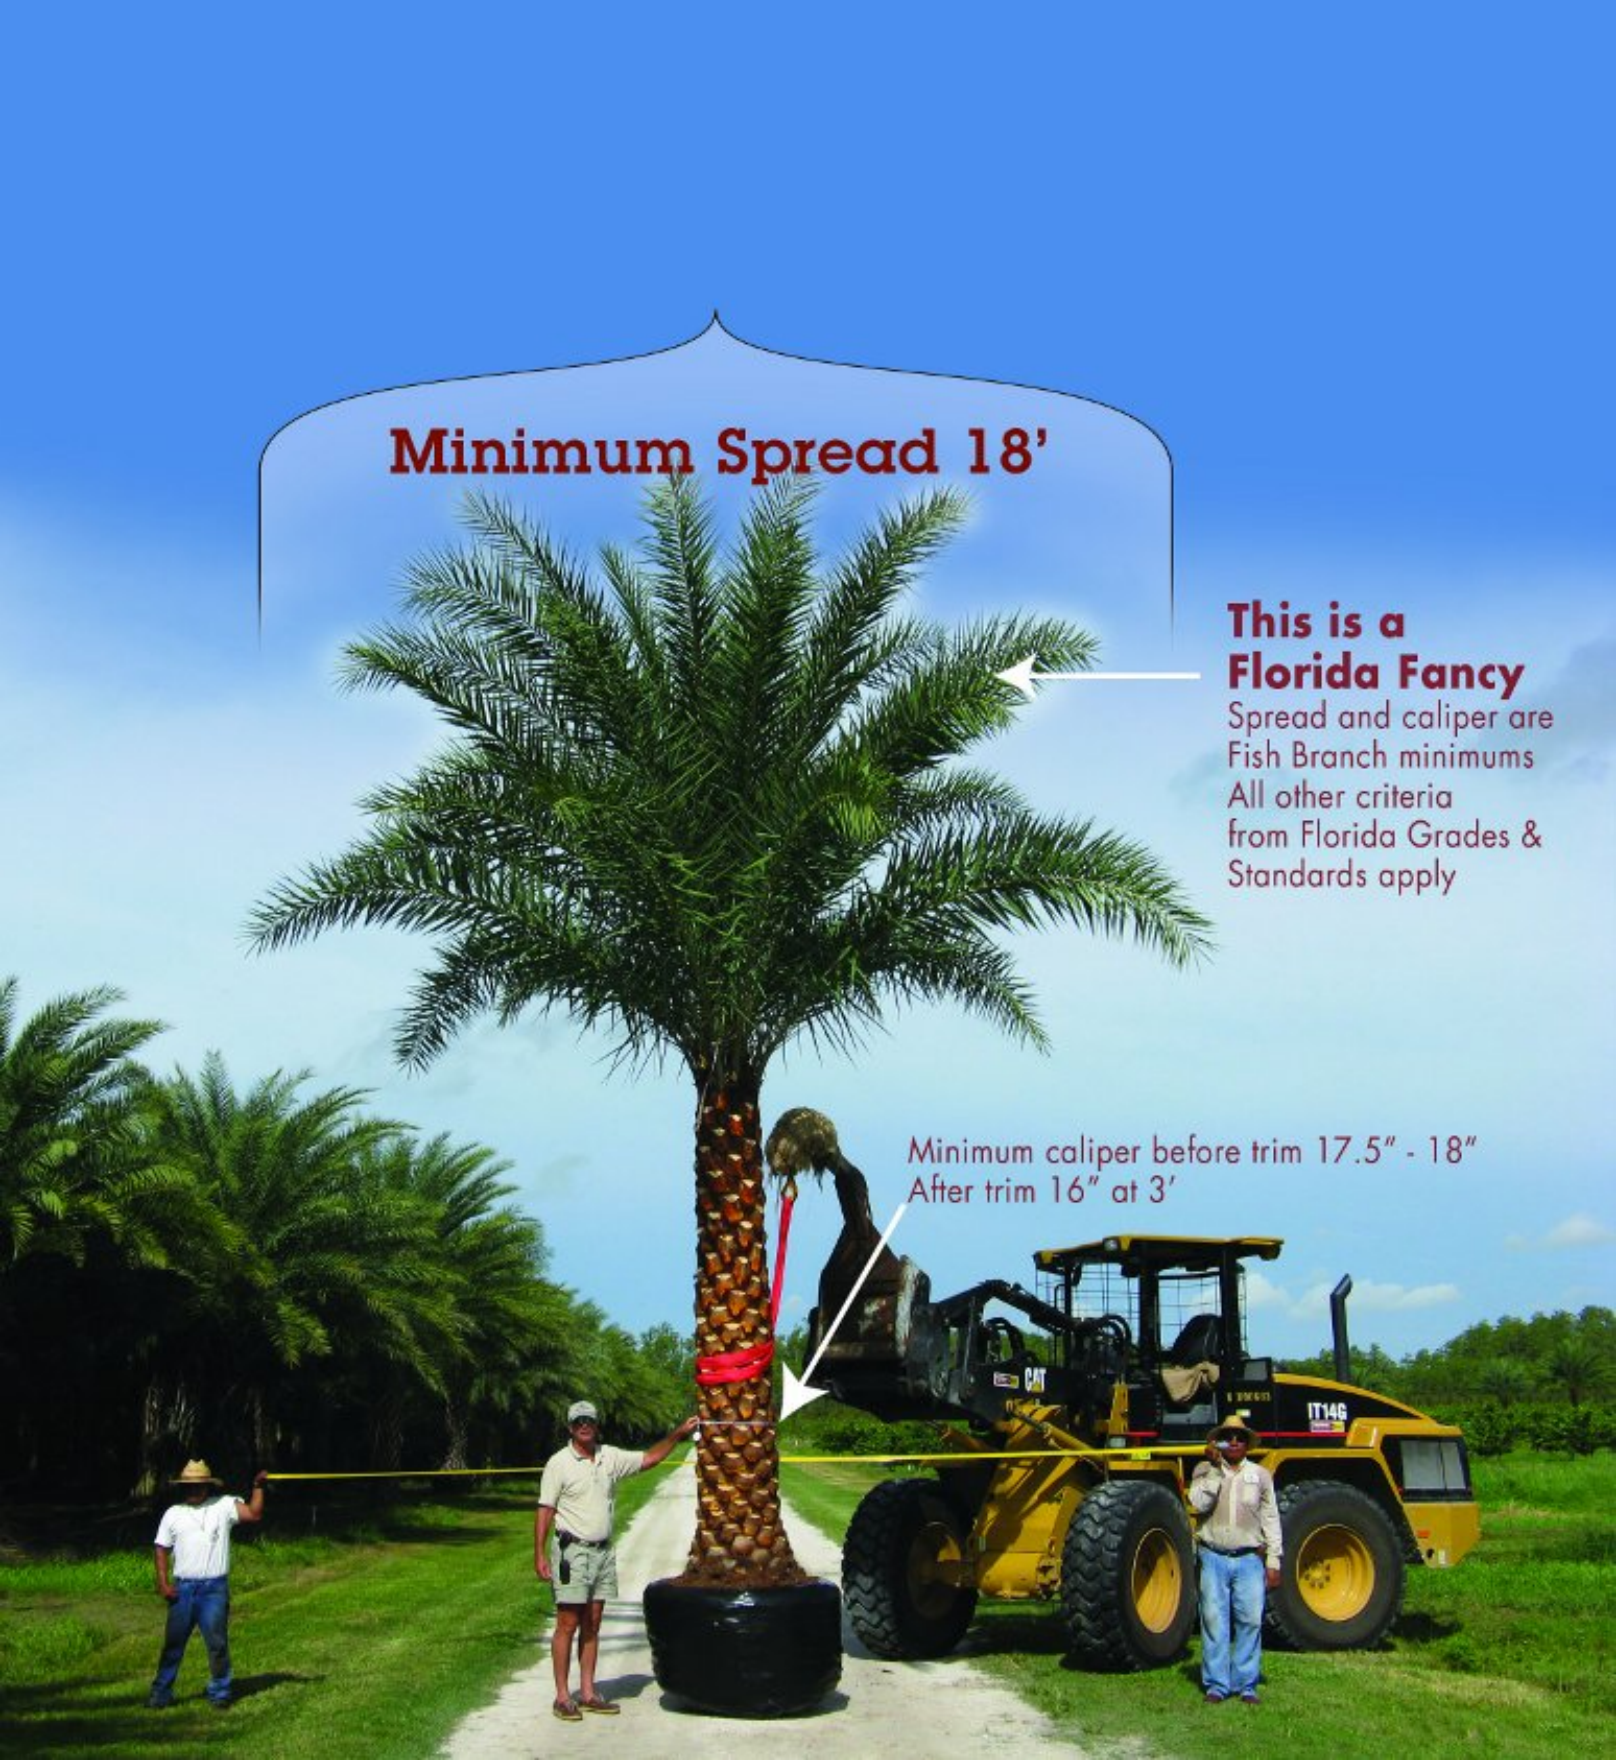

1680 Fish Branch Road  
Zolfo Springs, Florida 33890



Phone 863-735-2242  
Fax 863-735-2260

[www.fishbranchtreefarm.com](http://www.fishbranchtreefarm.com)

**THE FOLLOWING GRADES AND STANDARDS FOR PHOENIX SYLVESTRIS ARE BASED ON FLORIDA'S OFFICIAL GRADES & STANDARDS WITH MORE SPECIFIC CRITERIA AS APPLIED AT FISH BRANCH TREE FARM, INC.**

**CALIPER MEASUREMENTS ARE MADE AT 3 FEET FROM THE SOIL LINE.  
SPREAD MEASUREMENTS ARE MADE WITH FRONDS AT HORIZONTAL POSITION.**

**FLORIDA FANCY – MEETS OR EXCEEDS MINIMUM CALIPER AND SPREAD SPECIFICATIONS:**

**MINIMUM CALIPER: 17.5" TO 18" BEFORE TRIM 16" AFTER TRIM**

**MINIMUM SPREAD: 18 FEET**

**NO DOWNGRADING FACTORS EXIST**

**GRADE #1 –**

**CALIPER: 16" TO 17.5" BEFORE TRIM 14.5" TO 16" AFTER TRIM**

**SPREAD: 15 TO 18 FEET**

**GRADE #2 –**

**CALIPER: LESS THAN 16" BEFORE TRIM LESS THAN 14.5" AFTER TRIM**

**SPREAD: LESS THAN 15 FEET**

**STEPS TO GRADING:**

**STEP 1: MEASURE THE SPREAD AND CALIPER, DETERMINE THE LOWEST GRADE**

**STEP 2: CHECK FOR DOWNGRADING FACTORS:  
REDUCE THE GRADE DETERMINED IN STEP 1 BY ONE GRADE IF ANY OF THE  
DOWNGRADING FACTORS LISTED IN FLORIDA'S GRADES AND STANDARDS  
EXIST.**